


NOTES

- DOWN TO TYPE "M" FIXTURE LOCATED IN STAIRWELL ON FIRST FLOOR.
- UP TO TYPE "M" FIXTURE LOCATED IN STAIRWELL ON THIRD FLOOR.
- DOWN TO TYPE "L" FIXTURE LOCATED IN STAIRWELL ON FIRST FLOOR.
- LUTRON F818P 1800 WATT INCANDESCENT DIMMER.
- LUTRON F818P 3000 WATT INCANDESCENT DIMMER WITH F80-10 MOTOR DRIVE UNIT (LUTRON) AS SHOWN SHALL CONTROL MOTORIZED UNIT. MOUNT MOTORIZED UNIT AND DIMMER ABOVE CELLING.
- LUTRON F818P 1000 WATT INCANDESCENT DIMMER.
- FOUR CIRCUIT DIMMER BOARD, HALO 1870-AL MOUNTED AT 68" LIGHT TRACK SHOWN ON LEVEL 3 FLOOR PLAN. FOUR CIRCUIT SWITCHES FOR EACH CIRCUIT ON WALL, BELOW DIMMERS AT 18" AFF. 2A-21, 23, 25, 27).
- UP TO LIGHT TRACK SHOWN ON LEVEL 3 FLOOR PLAN (L-24, 25, 26, 28, 30).
- UP TO LIGHT TRACK SHOWN ON LEVEL 3 FLOOR PLAN (CIRCUITS 2A-24, 26, 28, 30).
- TO MOTORIZED DIMMER CONTROL. SEE NOTE 5
- OUTSIDE LAMPS OF EACH FIXTURE SHALL BE CONTROLLED BY SA AND INSIDE LAMPS OF EACH FIXTURE SHALL BE CONTROLLED BY SWITCH S6.
- SWITCHES S4 AND S2 SHALL CONTROL OUTSIDE LAMPS OF EACH OF EACH FIXTURE. LINES S5 AND S6 SHALL CONTROL INSIDE LAMPS OF EACH FIXTURE.
- CIRCUIT 2A, 17 SHALL CONTROL SWITCHES S4 AND S6. CIRCUIT 2A, 15 SHALL CONTROL SWITCHES S2 AND S6.
- DOWN TO TYPE "L" FIXTURE LOCATED ON LEVEL 1 FLOOR PLAN IN GRINDING AREA ROOM 1608. LIGHTING FIXTURES ON CIRCUIT 1L-8.
- TO 204-1P DUPLEX RECEPTACLE IN THIS ROOM.
- MOUNT STANDARD WALL SWITCH AT 48" AFF AND 1800 WATT LUTRON F818P DIMMER AT 60" AFF.
- MOUNT CENTER OF FIXTURE 15" ABOVE DOOR WAY OPENING.
- MOUNT ADDITIONAL TYPE "M" FIXTURE AT INTERMEDIATE LEVEL BELOW FIXTURE SHOWN.
- WIRING FOR ALL OUTSIDE LIGHTING FIXTURES SHALL BE 2410, 1810 GND-3/4" C. TYPICAL.
- ALL WORK TO THE RIGHT SHALL BE CONSIDERED INCLUDED IN THE BASE BID OF THIS PROJECT. ALL WORK TO THE LEFT SHALL BE INCLUDED IN THE ADDITIVE ALTERNATE #1 BID. THE TRANSFER FROM THE ADDITIVE ALTERNATE #1 TO THE BASE BID IN BOTH BASE AND ADDITIVE ALTERNATE #1 BID. REFER TO BID FORMS FOR ADDITIONAL INFORMATION.

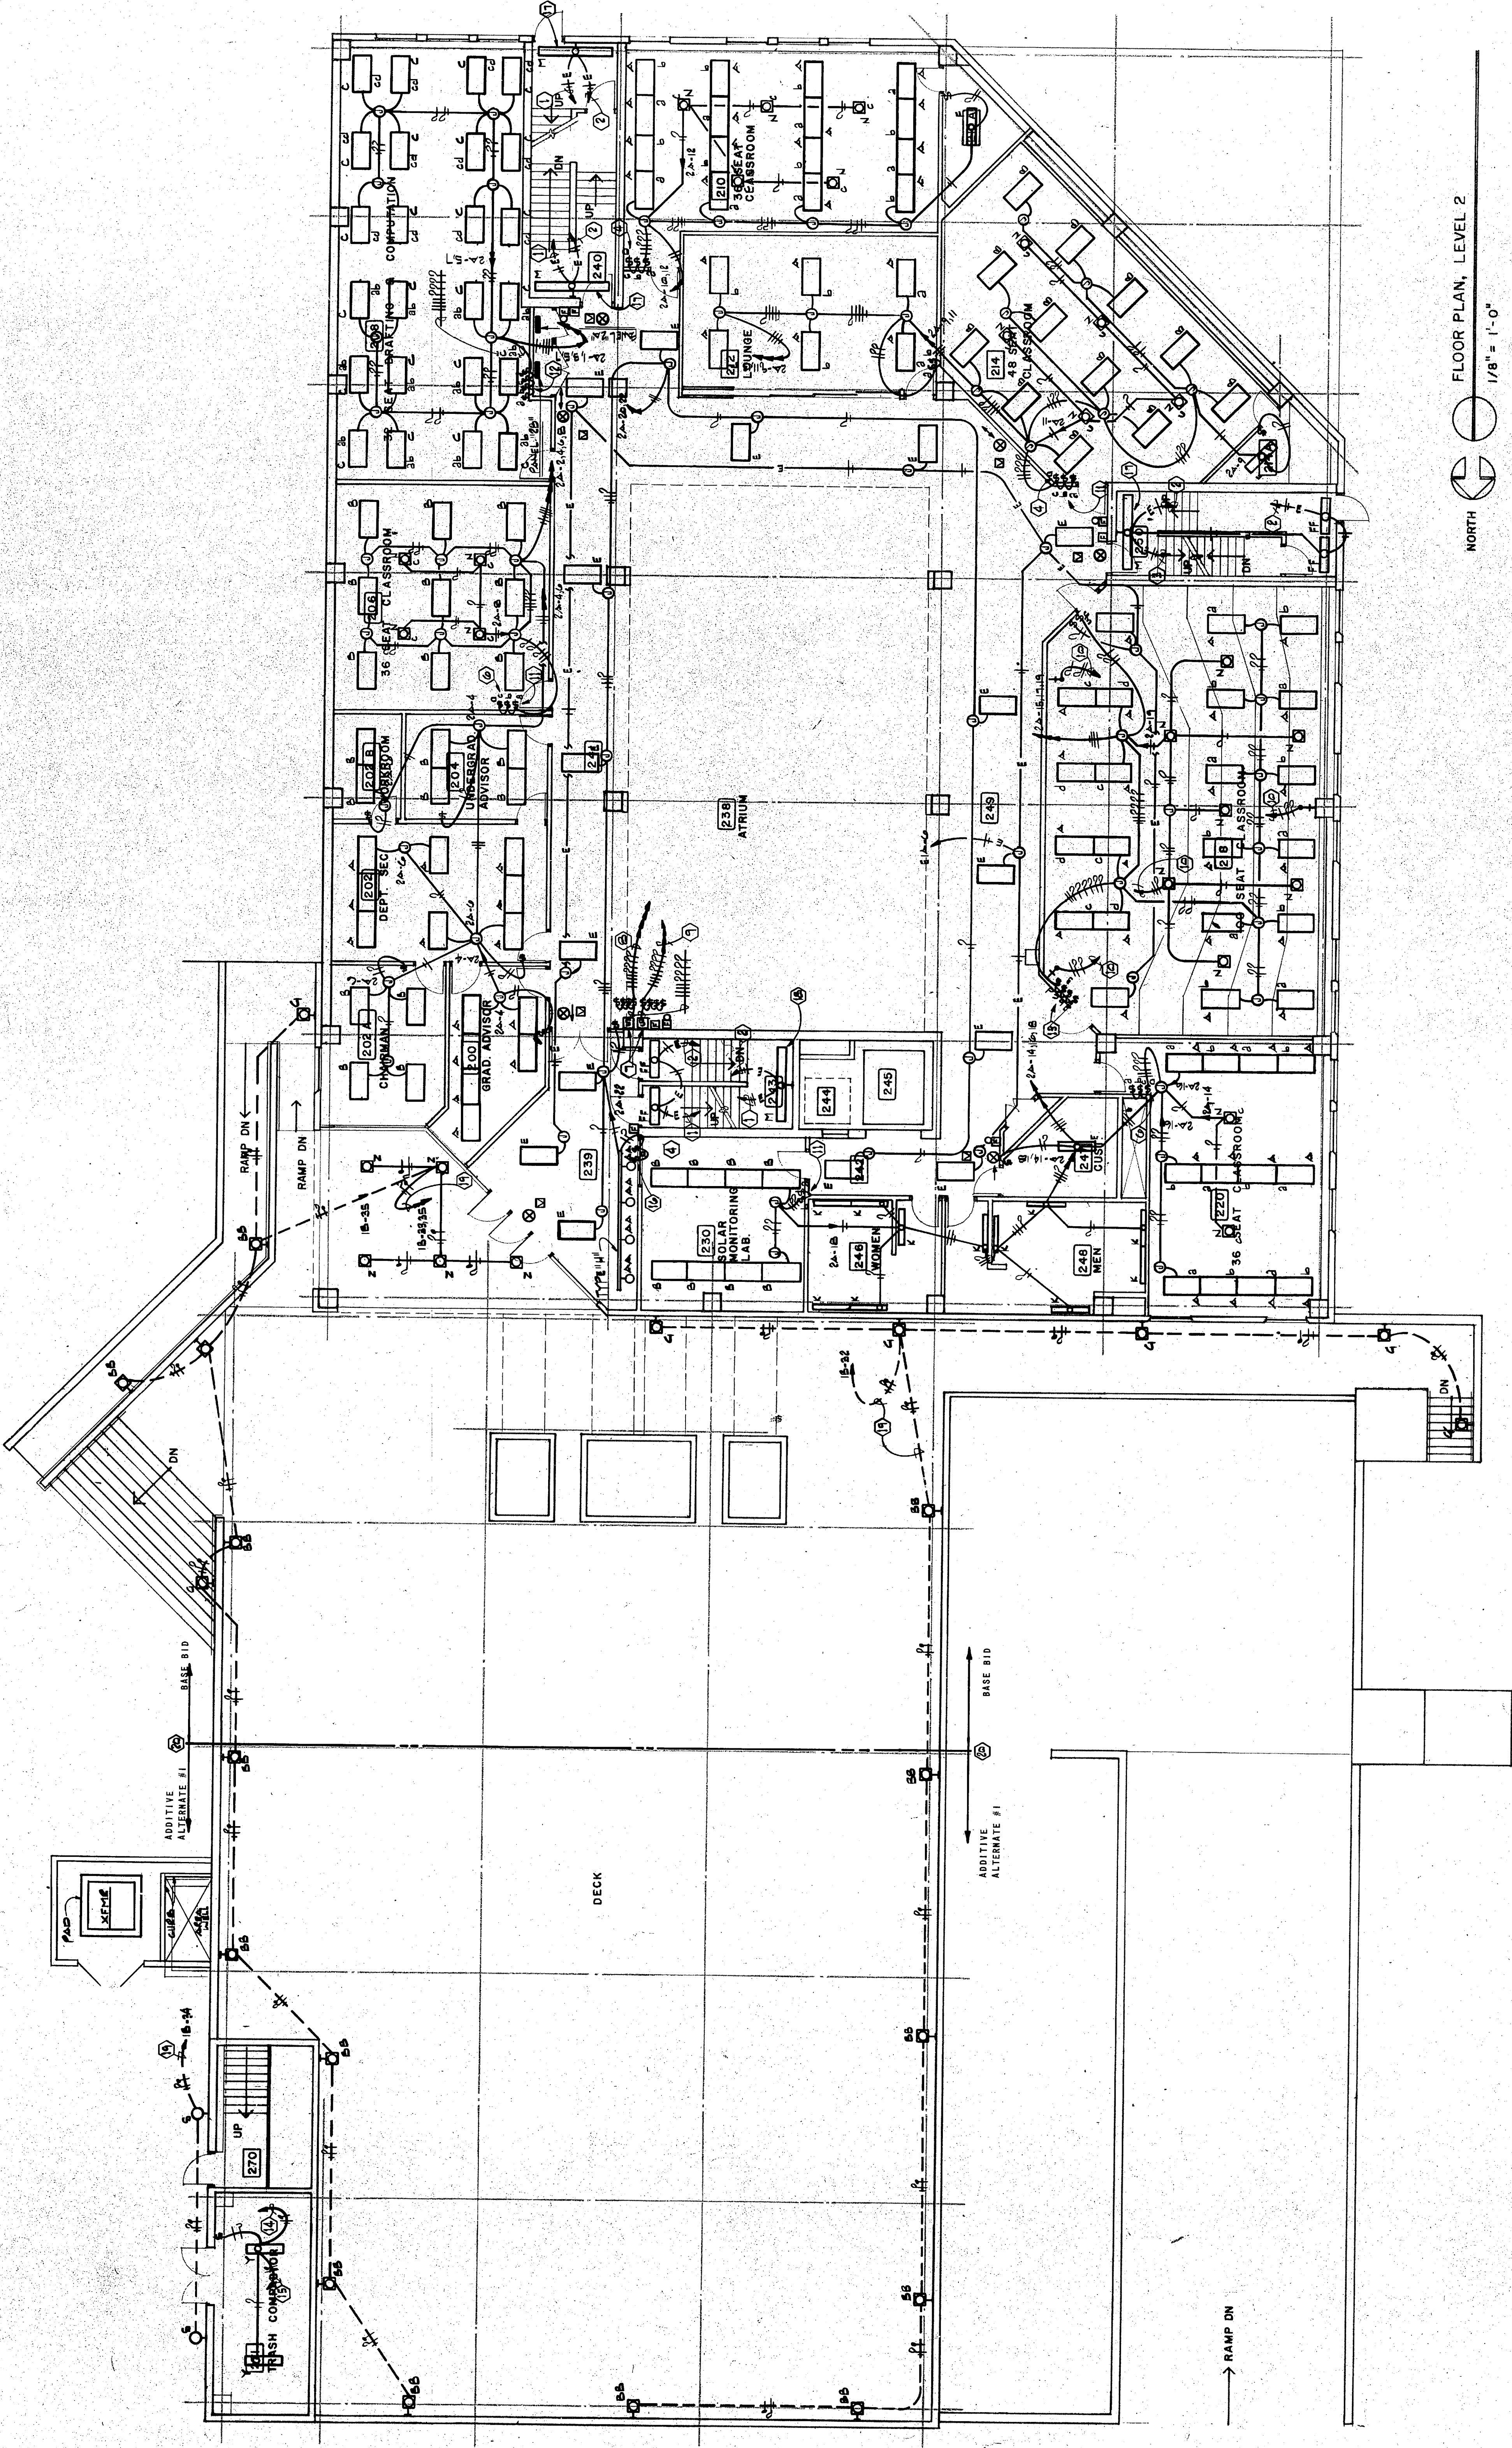

FLOOR PLAN, LEVEL 2
1/8" = 1'-0"