


NOTES

- 1 DOWN TO TYPE "M" FIXTURE LOCATED IN STAINWELL ON THIRD FLOOR.
- 2 SWITCHING IN THIS ROOM IS SUCH THAT THE OUTSIDE LAMP BY THE FRONT ENTRANCE IS SWITCHED BY S3 AND THE INSIDE LAMP BY S2.
- 3 MOUNT ADDITIONAL TYPE "M" FIXTURE AT INTERMEDIATE LEVEL BELOW FIXTURE SHOWN.
- 4 SUPPLY AND INSTALL FIRE ALARM PHOTO ELECTRIC SMOKE DETECTOR IN THIS ROOM. WIRE TO MECHANICAL FAN SYSTEM AS SHOWN ON LADDER CONTROL DIAGRAMS. VERIFY EXACT LOCATIONS IN FIELD.

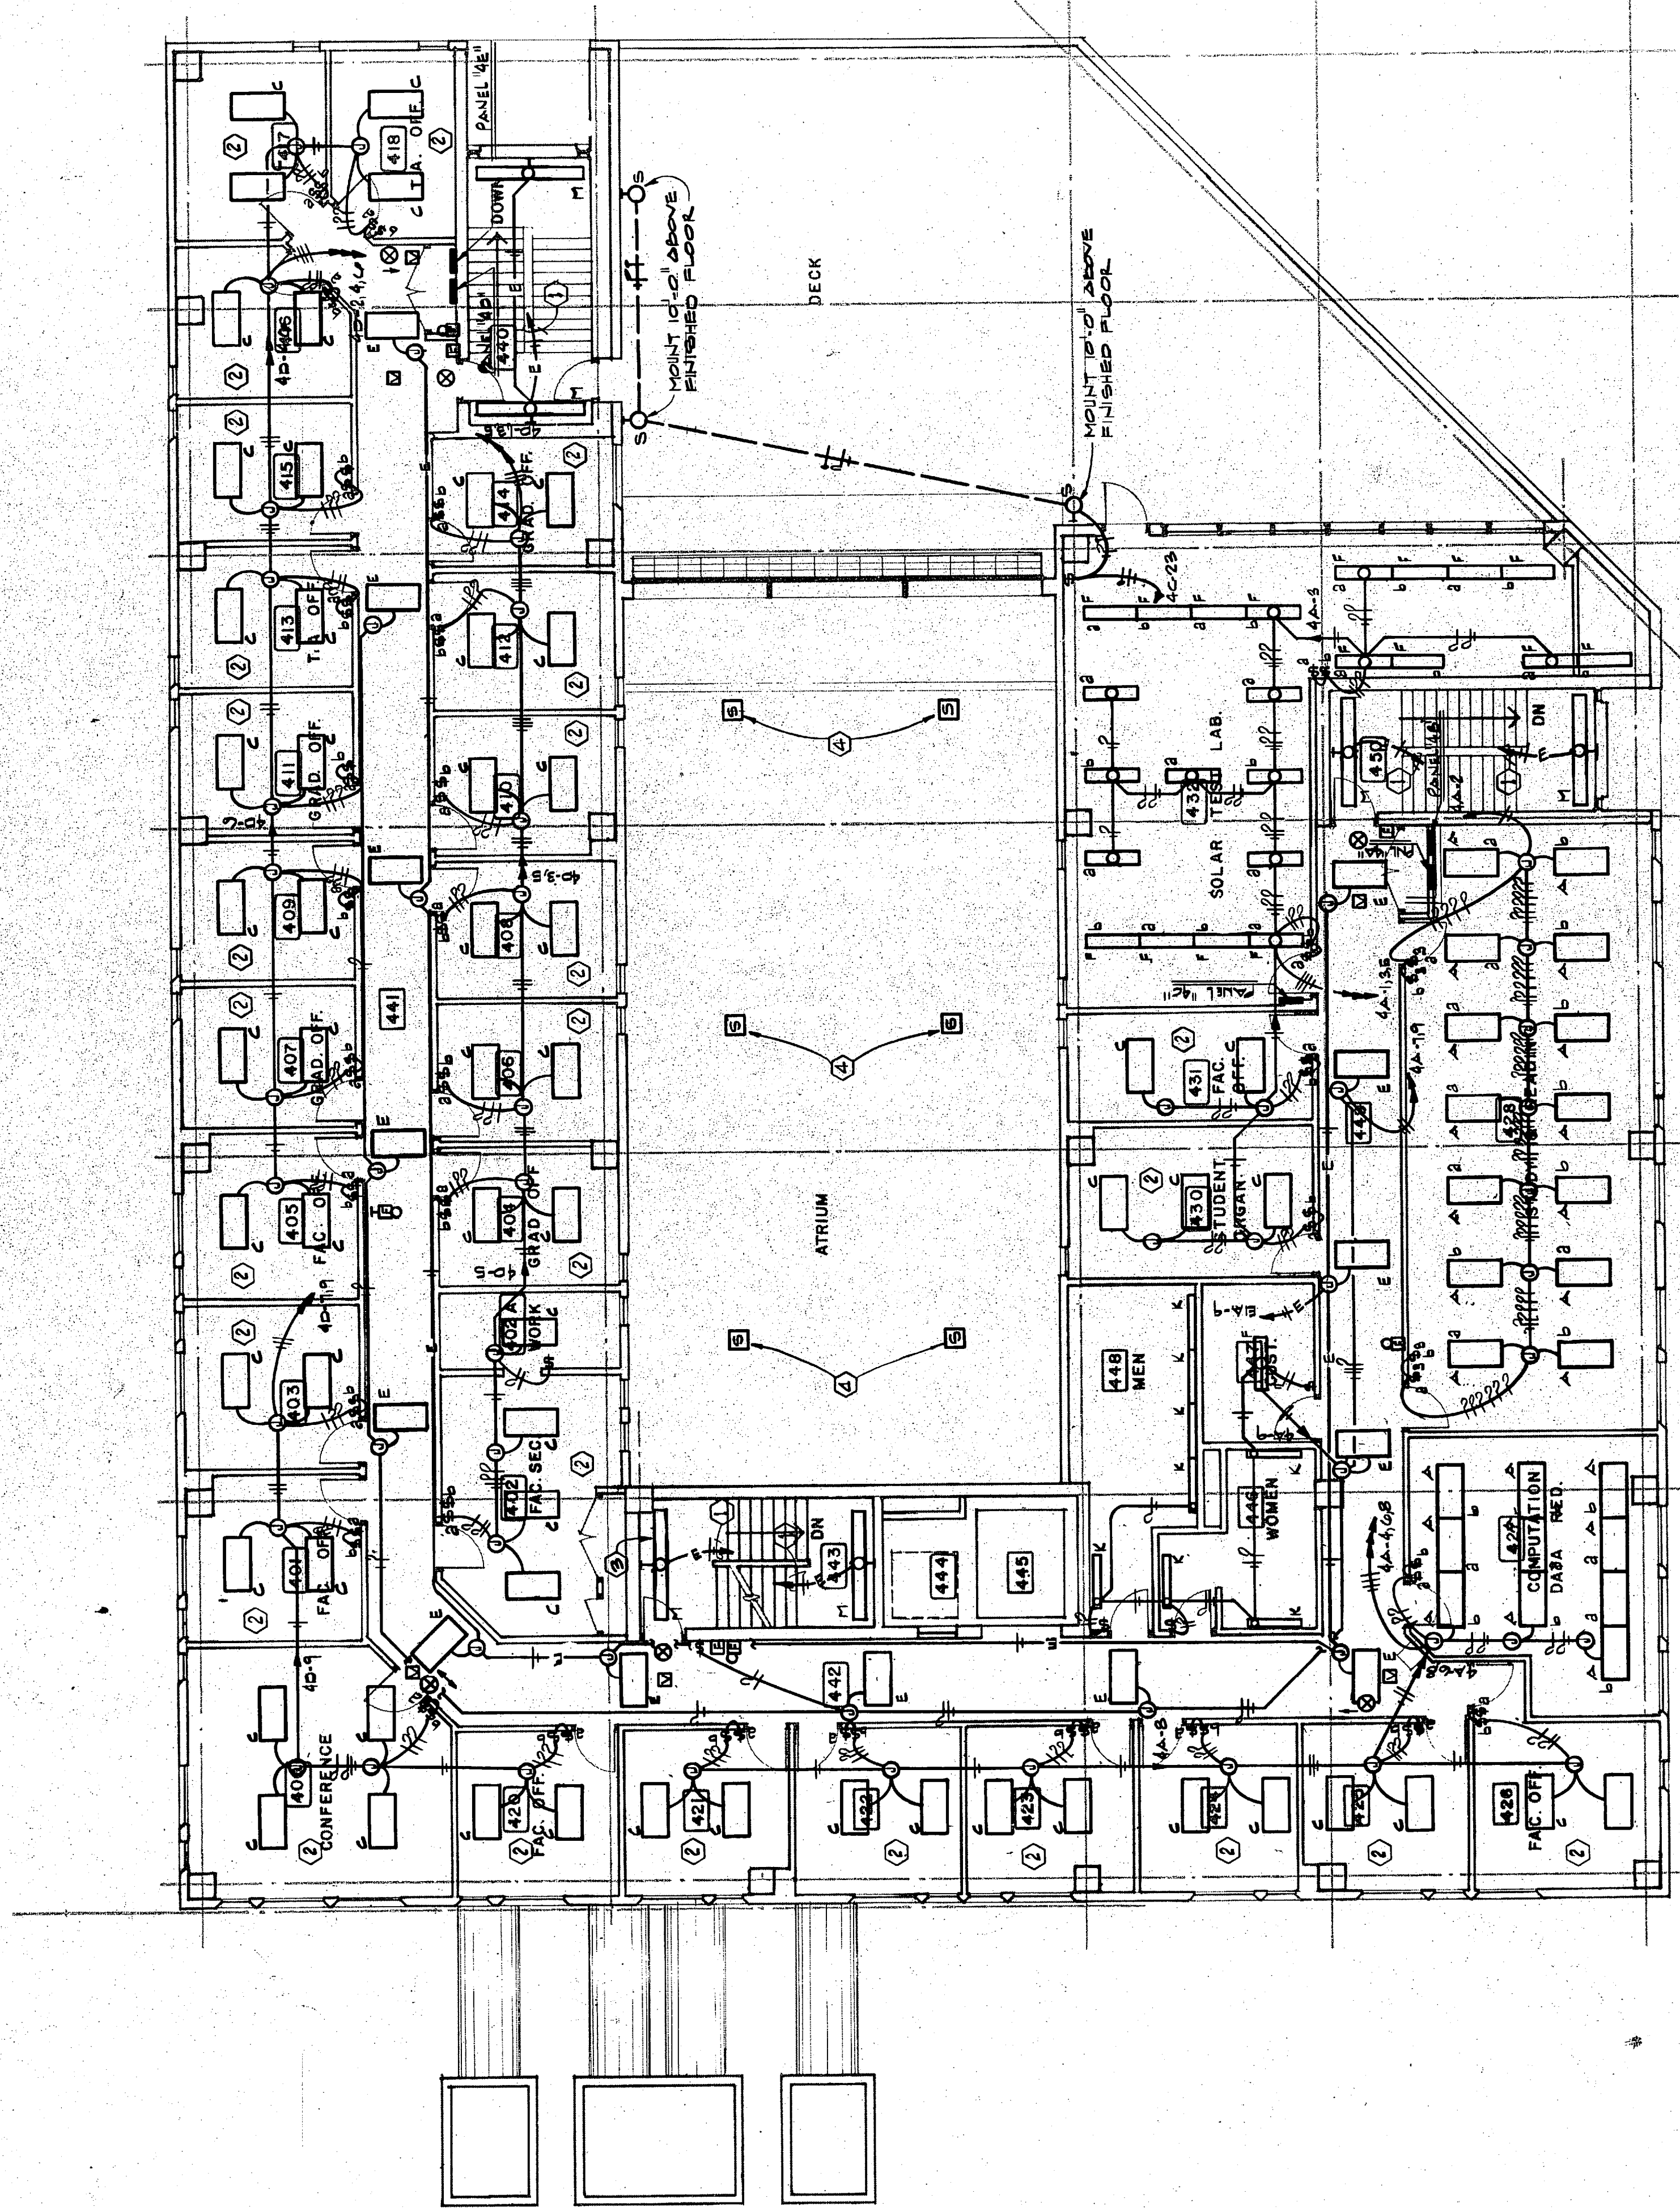

NORTH


FLOOR PLAN, LEVEL 4

1/8" = 1'-0"

UNM MECHANICAL ENGINEERING BLDG.

LEVEL 4 LIGHTING PLAN

pacheco and graham - architects
project
date 11/20/78
sheet F-8
E-R

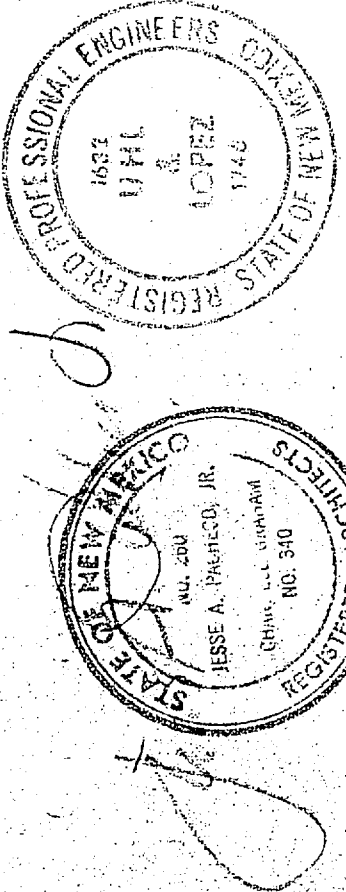

BASE 6/10/8